

**NO
EXCUSES!**



“A record of installed software and firmware version numbers shall be maintained at the location of the fire alarm control unit.”

eFAD

Fire Alarm Documents

The Space Age Electronics eFAD USB storage device has been developed to be a code compliant solution to a mandated item specified by the National Fire Code NFPA 72 section 6.2.2.1 states, “A record of installed software and firmware version numbers shall be maintained at the location of the fire alarm control unit.”

The eFAD is a designed solution to prevent the reoccurring problem of non billable service calls and lost revenue. When your service technician arrives to your customer’s location and the fire alarm software is not available due to it not being on site, not the right version or CD is damaged, it not only takes money directly from your bottom line, it can cause customer aggravation. These types of occurrences are typically caused by the previous technician forgetting to put the software back or the end-user misplacing it. None the less this causes downtime and customer retention issues.

The eFAD eliminates the need for the industry standard CD’s when making changes to the fire alarm software by storing your software on 2GB USB flash drive. It stores your fire alarm software safe and secure, eliminating the occurrences of the software not being on site when technicians arrive to service the system. Along with your fire alarm software you can store your test & inspection documents, service records, manuals & AS built drawings for the system. Using a standard USB B connector it allows you to plug in with any standard SB printer cable to upload or download information. Simply erase the old version and up load the new one with your changes.

Standard Features:

- Single gang electrical back box
- Standard Decora cover plate
- Can be mounted with other infinity single gang products
- Ensures that the files are always at the jobsite
- Easy access to a USB B port to files
- 2 GB flash drive, store electronically your T&I records, AS Built Drawings & service reports.
- Make changes to the fire alarm software without having to make a new CD.
- Durable steel frame mounts into an Infinity IGB Box or a standard electrical back box and securely holds the cover IGP plate.



**ISO 9001
REGISTERED
COMPANY**




**INFINITY SERIES
Modular Components**

Space Age Electronics, Inc.
www.1sae.com
800.486.1723 Toll Free
508.485.0966 Local
508.485.4740 Fax

Specifications:

The fire alarm documents shall be digitally stored within 6ft of the FACU panel. A Space Age Electronics eFAD shall be installed in a single gang electrical back box or a IGB series back box with a red Décor plate cover. The unit will be permanently marked "Fire Alarm Documents" and will not be able to be removed from the surface. The unit will install like an electrical device and be securely fastened. The eFAD unit shall have a minimum capacity of 2GB's of digital storage. The access will be a USB type B connector.

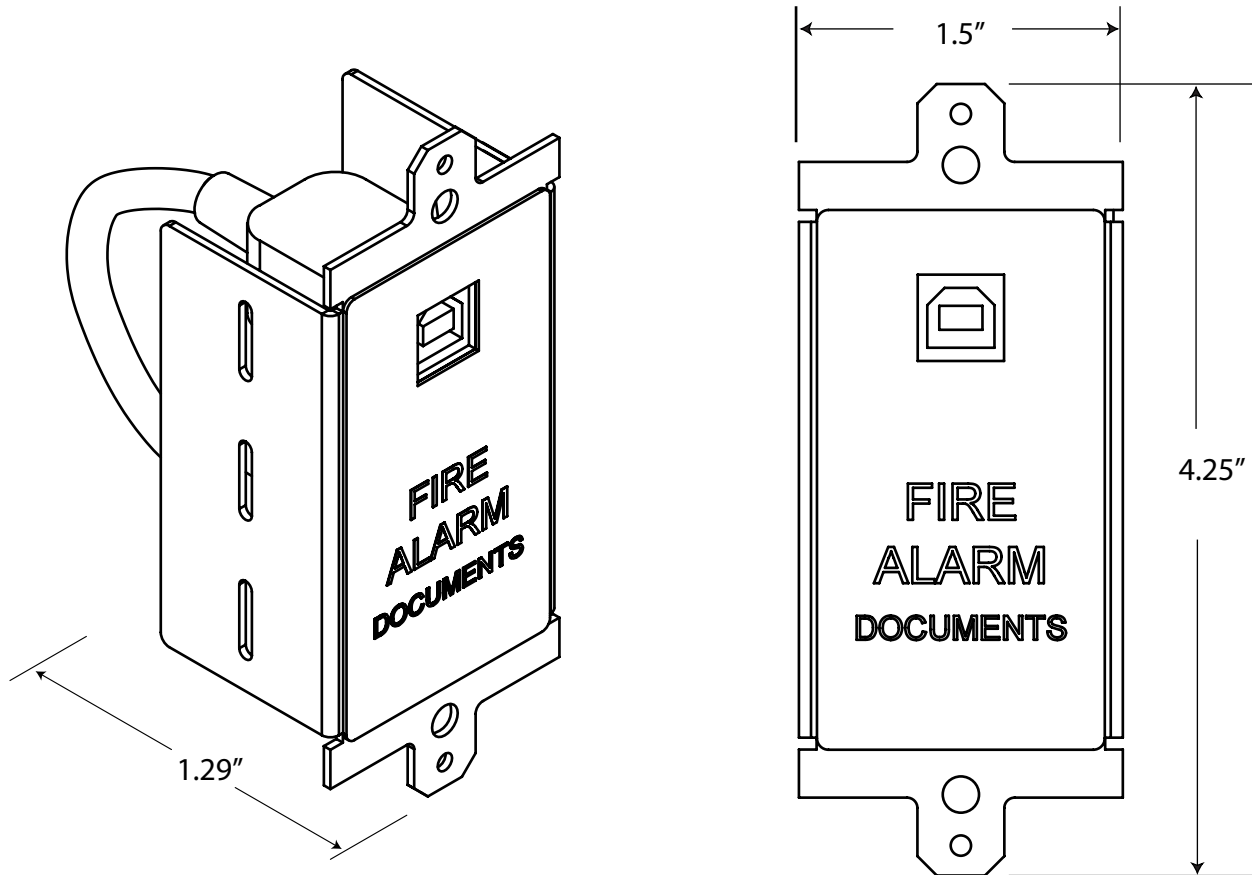

Ordering Information:

Part #	Description
IAMEFAD	eFAD Fire Alarm Documents



Space Age Electronics, Inc.
www.1sae.com
800.486.1723 Toll Free
508.485.0966 Local
508.485.4740 Fax